


WIRE TAG #	CONDUIT	WIRE QTY	WIRE GAUGE:	WIRE TYPE	TEMP RATING:	WIRE AMP	TEMP DE-RATE:	CONDUIT FILL:	WIRE OCP:	TERMINAL 75°C RATING:	STRING WATTAGE / OPERATING VOLTAGE = STRING AMPS x NEC: = MAX AMPS	MAX. SYSTEM VOLTAGE	GRND SIZE	GRND WIRE TYPE
1	Open Air	2	#10	PV WIRE	90°	40	x 0.96	x 1	= 38.40A	35 A	1215 / 380 = 3.20 x 1.25 = 4.00A	480	#6	SBC
2	3/4" EMT	2	#10	THWN-2	90°	40	x 0.96	x 1	= 38.40A	35 A	1215 / 380 = 3.20 x 1.25 = 4.00A	480	#10	THWN-2
3	3/4" EMT	3	#10	THWN-2	90°	40	x 0.96	x 1	= 38.40A	35 A	/ = 24 x 1.25 = 30.00A	240	#10	THWN-2
4	3/4" EMT	3	#6	THWN-2	90°	75	x 0.96	x 1	= 72.00A	65 A	/ = 24 x 1.25 = 30.00A	240	#8	THWN-2

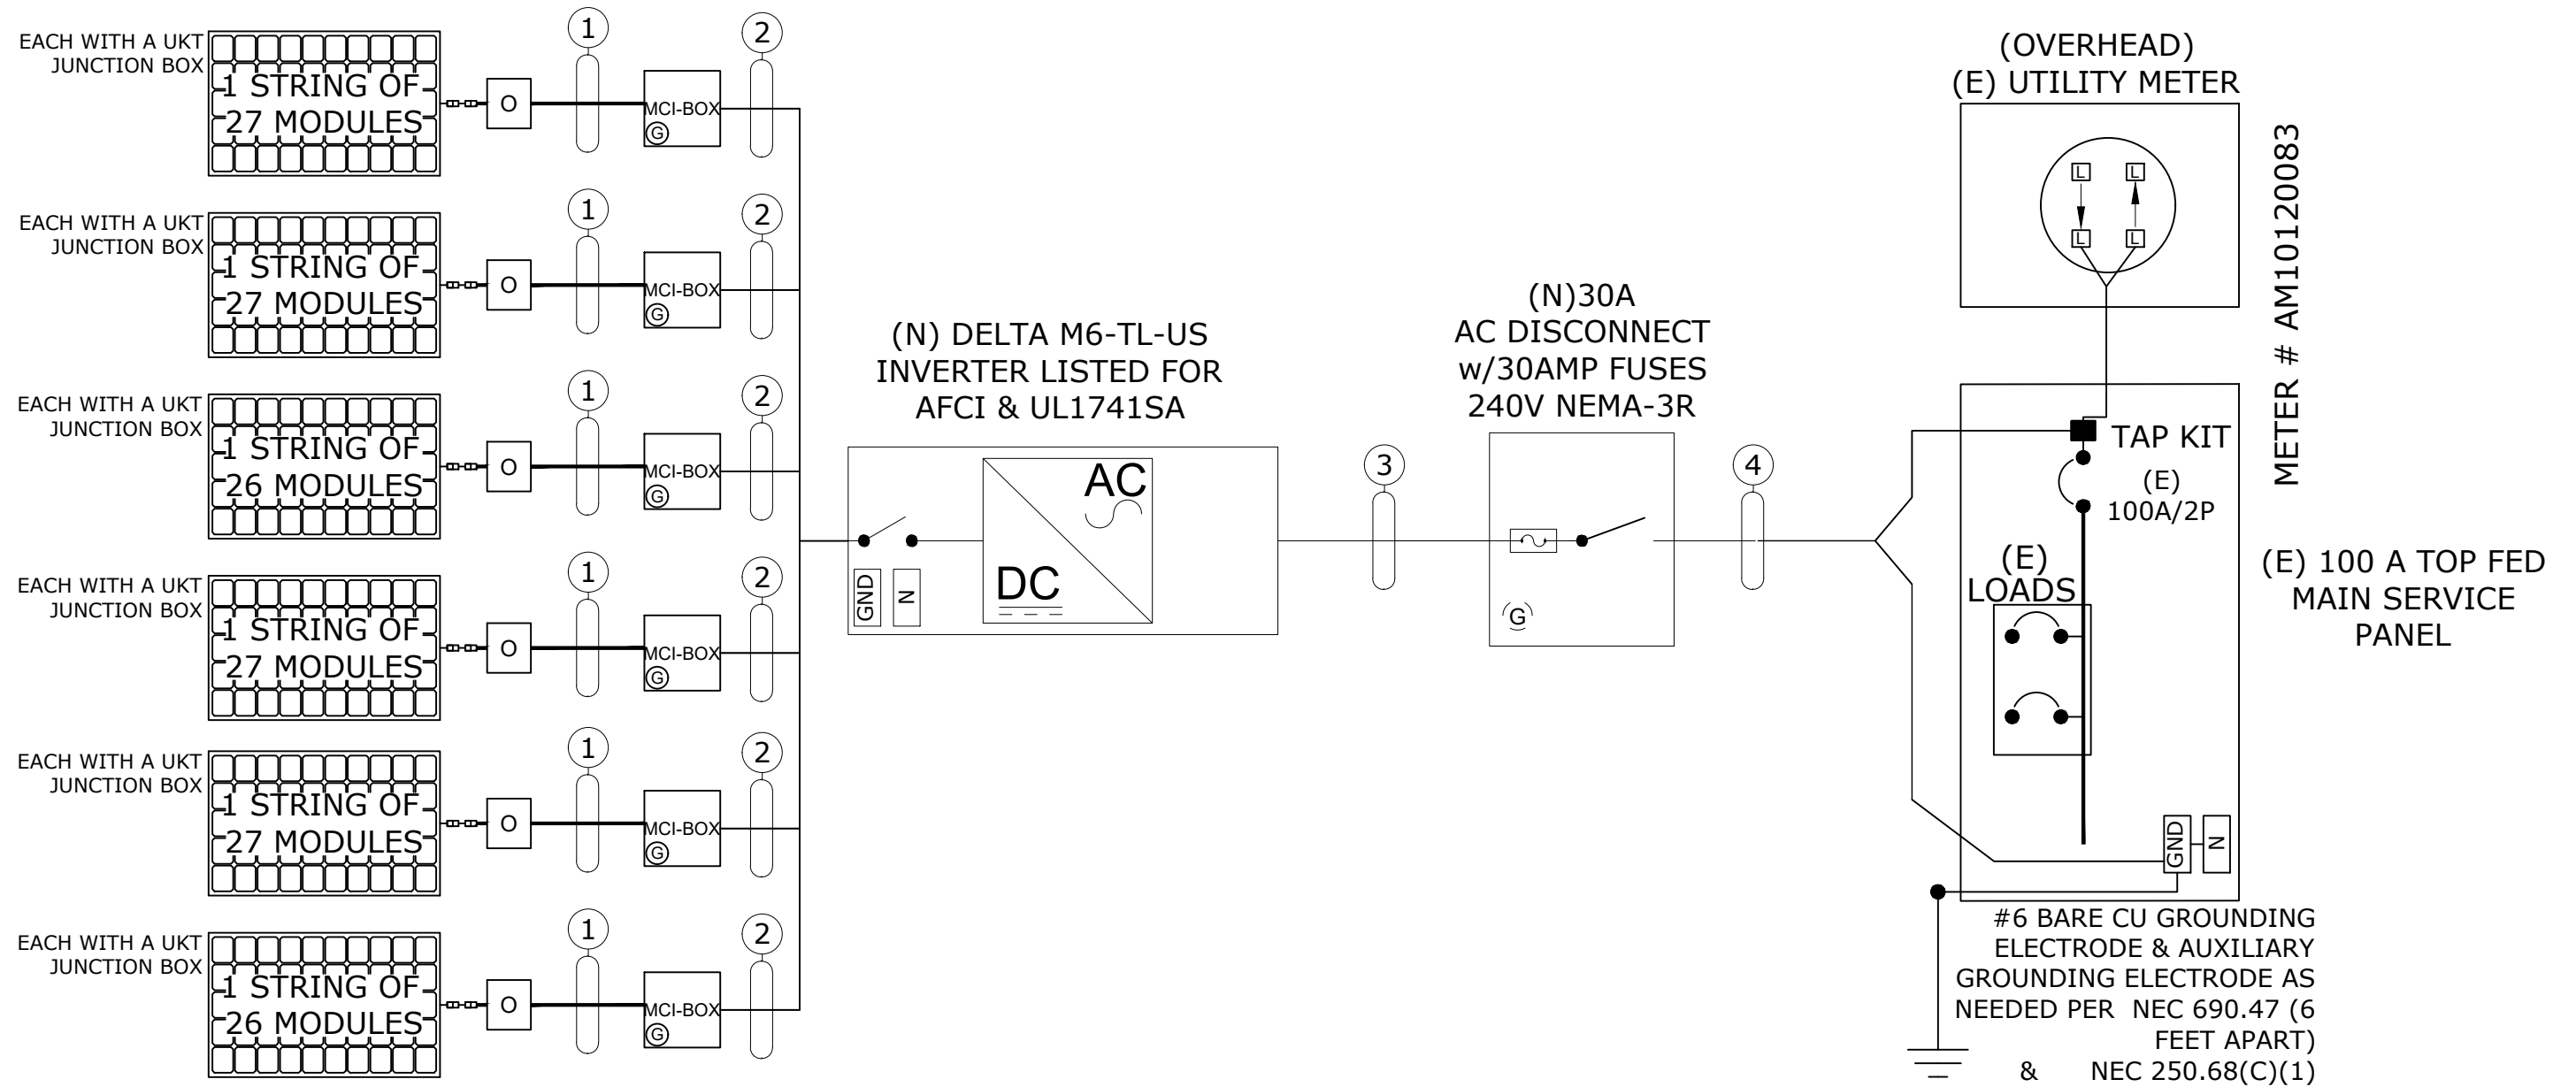

	JOB NUMBER: P-003338	OWNER:	DESCRIPTION:	STAMP:	PV-5
	UTILITY: ENERGY	ROBERT RIVERS, 4711 PAUGER STNEW ORLEANS, LA 70122	ROBERT RIVERS, RESIDENCE		
POSIGEN DEVELOPER, LLC 819 CENTRAL AVE STE 210 JEFFERSON, LA 70121 LA ELECTRICAL LICENSE :74446	RACKING: NAIL FLASHING	ACCOUNT NUMBER : 175379114	7.20 kWDC ROOF SOLAR SYSTEM PRODUCTION: 7,320kWH		PAGE NAME: SINGLE-LINE DIAGRAM
	MODULES: (160)SOLARSHINGLE TIMBERLINE SOLAR 45W				SCALE: NTS
	MCI: (6) MCI DELTA RAPID SHUTDOWN SYSTEM INVERTER: (1)DELTA M6-TL-US		DESIGNED BY: ENERQUAL	REV:	DATE: 9/20/2022

MODULE SPECS			
MODULE TYPE:	QTY:	WATTAGE:	
TIMBERLINE-SOLAR-45W	160	45W	
Voc: 10.9V	Isc: 5.14A	Imp: 4.89A	Vpmax: 9.03V

DELTA MID-CIRCUIT INTERRUPTER	
MAX OUTPUT POWER :	505W
QTY:	6
SYSTEM OPERATING VOLTAGE :	600V
NUMBER OF INPUT CIRCUIT :	1
RATED OUTPUT CURRENT :	12A

INVERTER SPECS		
INVERTER: DELTA-M4-TL-US		
QTY: 1		
VOLTAGE:	WATTAGE:	NEC EFF:
240	6000	98%

DISCONNECTS
MAKE: EATON DG221NRB
QTY: 1
RATED CURRENT: 30A
MAX RATED VOLTAGE: 240V


ASHRAE AMBIENT TEMPERATURE SPECS		
High Temp	DISTANCE ABOVE ROOF	EXTREME
2% Avg.	1"	MIN
34.2° C	NO TEMP ADDER PER 310.15(B)(3)(C)	-1.4° C

UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.

CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).

CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).

ALL BOS COMPONENTS SHALL BE INSTALLED WITHIN 10 FT OF ADJACENT COMPONENTS


 Solar Energy and Energy Efficiency	JOB NUMBER: P-003338	OWNER: ROBERT RIVERS, 4711 PAUGER ST NEW ORLEANS, LA 70122	DESCRIPTION: ROBERT RIVERS, RESIDENCE 7.20 kWDC ROOF SOLAR SYSTEM PRODUCTION: 7,320kWh	STAMP:	PV-5.1 PAGE NAME: SINGLE-LINE DIAGRAM
	UTILITY: ENERGY				
POSIGEN DEVELOPER, LLC 819 CENTRAL AVE STE 210 JEFFERSON, LA 70121 LA ELECTRICAL LICENSE :74446	RACKING: NAIL FLASHING	MCI: (6) MCI DELTA RAPID SHUTDOWN SYSTEM	DESIGNED BY: ENERQUAL	REV:	DATE: 9/20/2022
	MODULES: (160) SOLARSHINGLE TIMBERLINE SOLAR 45W				INVERTER: (1) DELTA M6-TL-US

GROUNDING NOTES	
1	ALL EQUIPMENT SHALL BE PROPERLY GROUNDED PER THE REQUIREMENTS OF NEC ARTICLES 250 & 690
2	INSTALLER SHALL CONFIRM THAT MOUNTING SYSTEM HAS BEEN EVALUATED FOR COMPLIANCE WITH UL 2703 "GROUNDING AND BONDING" WHEN USED WITH PROPOSED PV MODULE.
3	PV MODULES SHALL BE GROUNDED TO MOUNTING RAILS USING MODULE LUGS OR RACKING INTEGRATED GROUNDING CLAMPS AS ALLOWED BY LOCAL JURISDICTION. ALL OTHER EXPOSED METAL PARTS SHALL BE GROUNDED USING UL-LISTED LAY-IN LUGS.
4	GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLOR CODED GREEN, OR MARKED GREEN IF #4AWG OR LARGER
5	AC SYSTEM GROUNDING ELECTRODE CONDUCTOR (GEC) SHALL BE A MINIMUM SIZE #8AWG WHEN INSULATED, #6AWG IF BARE WIRE.
6	IF THE EXISTING MAIN SERVICE PANEL DOES NOT HAVE A VERIFIABLE GROUNDING ELECTRODE, IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSTALL A SUPPLEMENTAL GROUNDING ELECTRODE.

7
EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED ACCORDING TO NEC ARTICLE 690.45, AND BE A MINIMUM OF #10AWG WHEN NOT EXPOSED TO DAMAGE, AND #6AWG SHALL BE USED WHEN EXPOSED TO DAMAGE

NOTES :

- MATING CONNECTORS SHALL COMPLY WITH NEC 690.33.
- SOLAR EDGE SYSTEM MEETS REQUIREMENTS FOR PHOTOVOLTAIC RAPID SHUTDOWN SYSTEM (PVRSS), AS PER NEC 690.12(B).
- THE SPECIFIED OPTIMIZER CAN BE SUBSTITUTED WITH A P400, P405, P505, P401, OR P485. THESE OPTIMIZERS HAVE AN INPUT VOLTAGE WINDOW WIDE ENOUGH TO ACCOMMODATE THE OUTPUT VOLTAGE RANGE OF THE MODULE AT THE DESIGN TEMPERATURES, HAVE A MAX INPUT CURRENT RATING THAT IS ABOVE THE MAX OUTPUT CURRENT OF THE MODULE, AND A MAX POWER INPUT THAT IS ABOVE THE RATED POWER OUTPUT OF THE MODULE.
- DC PV CONDUCTORS ARE NOT SOLIDLY-GROUNDED. NO DC PV CONDUCTOR SHALL BE WHITE- OR GRAY-COLORED
- ALL METAL ENCLOSURES, RACEWAYS, CABLES AND EXPOSED NONCURRENT-CARRYING METAL PARTS OF EQUIPMENT SHALL BE GROUNDED TO EARTH AS REQUIRED BY NEC 250.4(A) AND PART III OF ARTICLE 250 AND EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED ACCORDING TO NEC 690.45. THE GROUNDING ELECTRODE SYSTEM SHALL ADHERE TO NEC 690.47(A) AND NEC 250.169. THE DC GROUNDING ELECTRODE SHALL BE SIZED ACCORDING TO NEC 250.166 AND INSTALLED IN COMPLIANCE WITH NEC 250.64.
- MAX DC VOLTAGE OF ARRAY FIXED BY THE INVERTER AT 380V REGARDLESS OF TEMPERATURE. THE MAX DC VOLTAGE OF THE MODULE AT -15°C IS 53.2V (-15°C - 25°C) X -0.138V/C + 47.7V = 53.2V).
- POINT-OF-CONNECTION IS ON THE SUPPLY SIDE OF SERVICE DISCONNECT, INSIDE PANELBOARD ENCLOSURE USING UNUSED TERMINALS, TERMINALS THAT ARE SUITABLE FOR DOUBLE LUGGING, OR USING OTHER LOCALLY-APPROVED METHODS AND HARDWARE, IN COMPLIANCE WITH NEC 705.12(A). THE PANELBOARD SHALL HAVE SUFFICIENT SPACE TO ALLOW FOR ANY TAP HARDWARE AS REQUIRED BY NEC 110.3 AND NEC 312.8(A)
- PV SYSTEM DISCONNECT SHALL BE A VISIBLE KNIFE-BLADE TYPE DISCONNECT THAT IS ACCESSIBLE AND LOCKABLE BY THE UTILITY. THE DISCONNECT SHALL BE LOCATED WITHIN 10 FT OF UTILITY METER. DISCONNECT SHALL BE GROUPED IN ACCORDANCE WITH NEC 230.72.

 <p>POSIGEN DEVELOPER, LLC 819 CENTRAL AVE STE 210 JEFFERSON, LA 70121 LA ELECTRICAL LICENSE :74446</p>	JOB NUMBER: P-003338	OWNER:	DESCRIPTION:	STAMP:	<p>PV-5.2</p> <p>PAGE NAME: ELECTRICAL NOTES</p> <p>SCALE: NTS</p> <p>DATE: 9/20/2022</p>
	UTILITY: ENERGY	ROBERT RIVERS, 4711 PAUGER STNEW ORLEANS, LA 70122	ROBERT RIVERS, RESIDENCE	<p>7.20 kWDC ROOF SOLAR SYSTEM PRODUCTION: 7,320kWH</p>	
	RACKING: NAIL FLASHING	ACCOUNT NUMBER : 175379114	DESIGNED BY:		
	MODULES: (160)SOLARSHINGLE TIMBERLINE SOLAR 45W	MCI: (6) MCI DELTA RAPID SHUTDOWN SYSTEM	ENERQUAL		
	INVERTER: (1)DELTA M6-TL-US				